

EV-AS Adjustable Stroke Chain Drive.

EV-AS



● SAFETY NOTES

- Test the actuator at least one working cycle to make sure it works well before the installation.
- Before installation make sure the stroke of the actuator is smaller than the max opening range of the window sash.
- The housing and chain cannot clash or be blocked by the window frame, they need to be at least 3mm away from it.
- Make sure the power is disconnected before installation.
- Do not put your hands between the window sash and frame when the actuator is working.
- Trained professional staff only for the installation.
- Indoor use only.
- Before installation, find out the input voltage of the actuator is DC24V or AC230V.
- Before installation, make sure the window is free of resistance.
- Regularly check the aging condition of the wire and fastening screws, at least once a year.
- Please do not rotate the stroke control switch when the power is connected.



TECHNICAL INFORMATION

Please refer to the product datasheet for technical information and key specifications.

● INSTALLATION INSTRUCTIONS

STEP 1

Find the point to fix the connector. Horizontally it must be in the middle of window frame, vertically it needs to be in a proper position, which can make the chain and casing move freely and without clashing or being blocked by the window frame, as displayed in Picture 1.





STEP 2

Fix the connector with 2 pcs ϕ 5*25mm self-tapping screws, as displayed in Picture 2.

STEP 3

Find the positions for mounting brackets according to the position of the connector. The chain needs to come in/out vertically to the housing of the actuator. Fix each mounting bracket with 3 pcs ϕ 5*25mm self-tapping screws, as displayed in picture 3.





STEP 4


Put the actuator between the 2 mounting brackets, fix it with 1 pc hex head screw on each side. Insert the latch into the connector and head of chain, screw it tightly, as displayed in picture 4.

STEP 5


There are 2 different ways to fix the mounting brackets, depending on whether there is a window sill, as displayed in Pictures 5 & 6.




TECHNICAL DRAWINGS AND APPLICATIONS

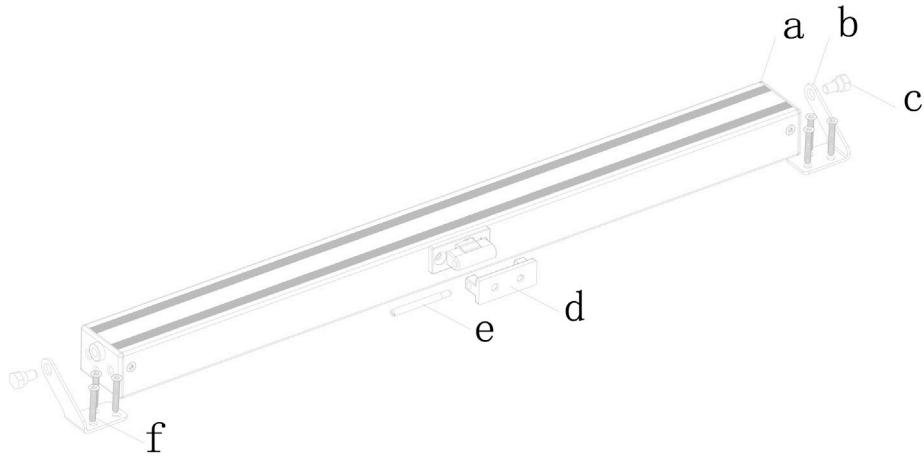

	a	b	c	d	e	f
Description	Chain Actuator	Side Mounting Bracket	Hex Head Screw	Chain Connector	Chain Connector Pin	Self-tapping Screw
Quantity	1	2	2	1	1	8

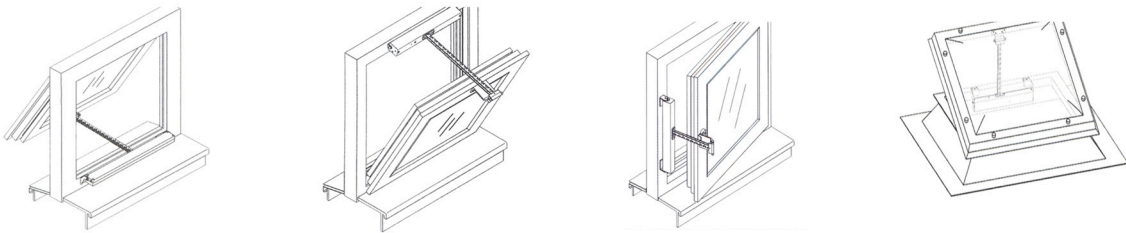

WIRING DIAGRAM

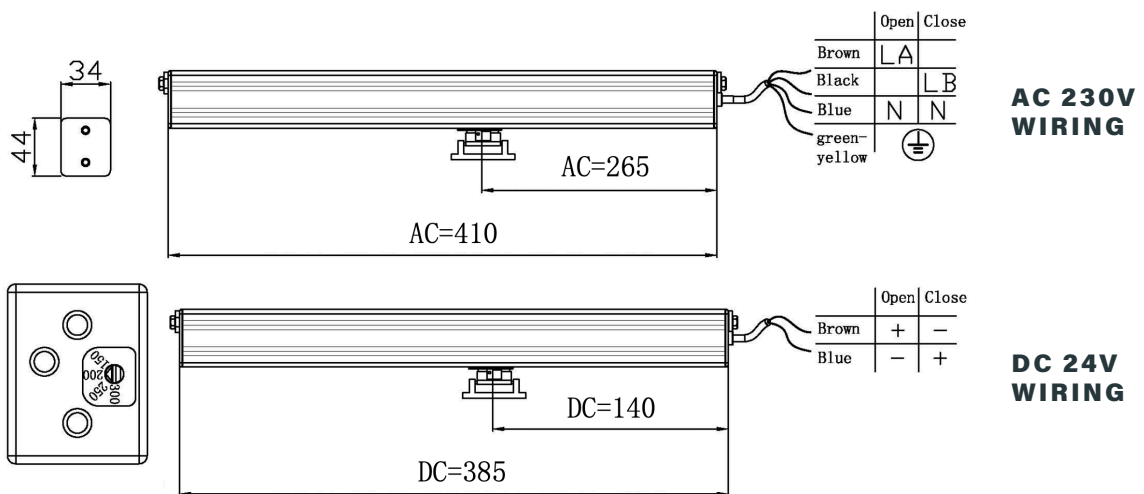

ATTENTION: Under the Construction Products Regulations (CPR) it is a legal requirement to use only certified products for smoke ventilation. It is the responsibility of the installer to ensure installations meet the relevant standards.

SCS Group reserves the right to alter the specification of its products from time to time without notice. Although every effort has been made to ensure the accuracy of the information contained in this document it is not warranted or represented by SCS Group to be a complete and up-to-date description. For further information visit www.groupscs.co.uk